

96 Channel Infrastructure Analyzer Installation Instructions


Product Covered: HCS Cabling Systems Part Number PB-PF08-0900

Important Safety Notices

- ## Product Overview

The Phy-FiXX Channel Infrastructure Analyzer communicates with the Phy-FiXX patch panels to collect data regarding changes in the physical structured cable plant and to drive patch guidance LEDs on the panels. The Channel Infrastructure Analyzer is connected to each patch panel through industry-standard RJ45 patch cords. The Channel Infrastructure Analyzer also provides power to all the patch panels through the communication bus cables.

Each Channel Infrastructure Analyzer can be connected to eight 24-port Phy-FiXX patch panels, providing for a total capacity of 96 channels in a cross-connect environment. The following figure shows the general architecture of a Phy-FiXX System, and illustrates how the Channel Infrastructure Analyzer communicates with both the server and Phy-FiXX patch panels.

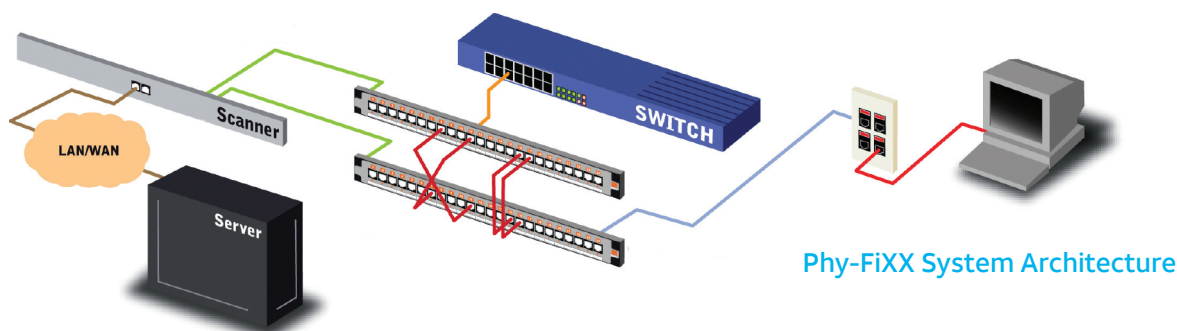

HCS Phy-FiXX™

96 Channel Infrastructure Analyzer Installation Instructions

On the front of the Channel Infrastructure Analyzer are:

Status Lights.


Lights S1 and S2 indicate communication with the network and operation of the scanning function. Lights P1-P2 indicate proper operation of the electronics inside the Channel Infrastructure Analyzer.

Reset ("RST") button.

A recessed button that is rarely used for resetting the unit.

LAN Port.

The port labelled LAN is for connection to the network. The LAN port operate at either 10 or 100 Mb/s,

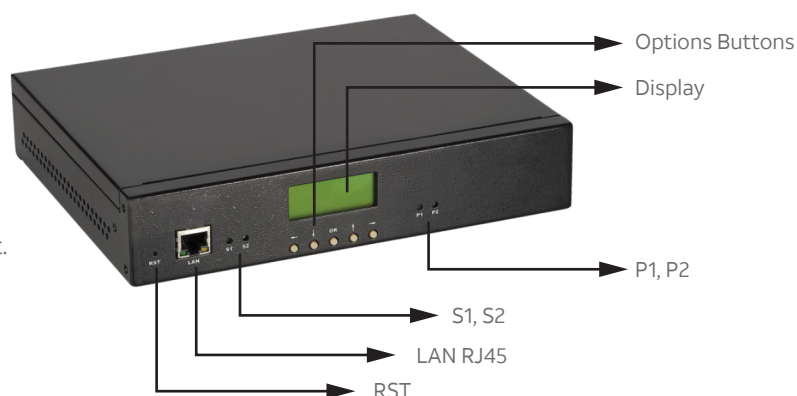


Front View of Channel Infrastructure Analyzer

On the rear of the Channel Infrastructure Analyzer are:

AC Power socket: This is an IEC-60320 C14 power socket for use with a standard power cable. The power socket has an integrated 1.0 amp fuse.

Channel Infrastructure Analyzer Communication Bus Ports: There are a total of 8 Channel Infrastructure Analyzer ports. four are for connection to Horizontal Panels (also known as "Patch Panel" or PP) and four are for connection to Equipment Panels (also known as Cross-connect panels or CC). It is recommended that patch panels be connected in order to ports 1-4 as needed.

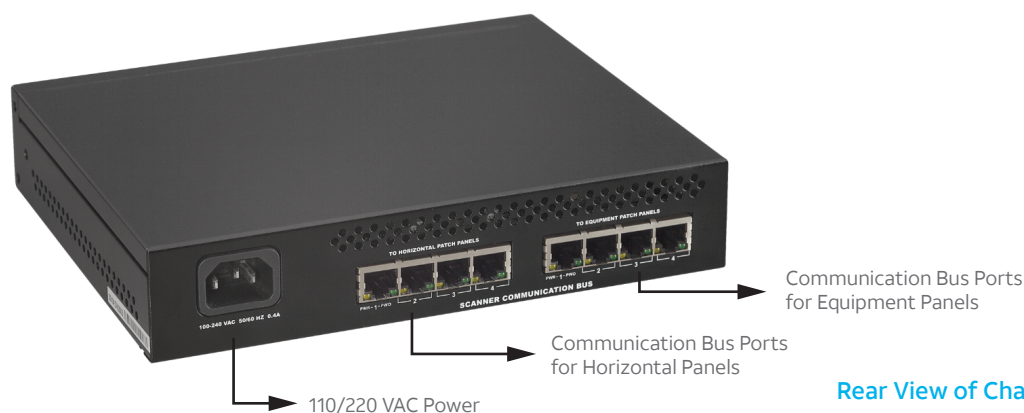

Rear View of Channel Infrastructure Analyzer

Items Not Included

To complete the installation of the Phy-FiXX Channel Infrastructure Analyzer you will need to procure:

- One power cord, to connect the Phy-FiXX Channel Infrastructure Analyzer to a 110-volt or 220-volt AC power supply. The end of the power cord that connects to the Channel Infrastructure Analyzer must be equipped with an IEC-60320 C13 power connector. For North American applications use a powercord that is UL-listed or CSA certified, the cord must be 3-conductor, 18 AWG, not longer than 4.5 meters, with a plug rated for 125V and 15A. For European applications use a power cord that is internationally harmonized and marked <HAR>, 3-conductor 0.75mm² minimum wire, rated 300V with a PVC jacket and plug rated for 300V and 10A.
- Communication Bus Cables – one cable is required for each Phy-FiXX patch panel that is to be connected to the Channel Infrastructure Analyzer. These cables must be 8-wire, minimum 24 AWG conductors, and must be equipped with industry-standard RJ45 connectors at both ends. In general any standard Category 5e UTP or better patch cord will work. The maximum allowable length of the communication bus cable is 50 meters.


HCS Phy-FiXX™

96 Channel Infrastructure Analyzer Installation Instructions

Installation Steps

The steps to install the Channel Infrastructure Analyzer and connect to Phy-FiXX Patch Panels are:

1. Mount the Channel Infrastructure Analyzer in rack, using screws and/or cage nuts as required for your particular rack or cabinet. Ensure that sufficient room is available at the rear of the Channel Infrastructure Analyzer to connect the Communication Bus Cable. Allow for adequate ventilation around the unit, and do not obstruct any ventilation openings.

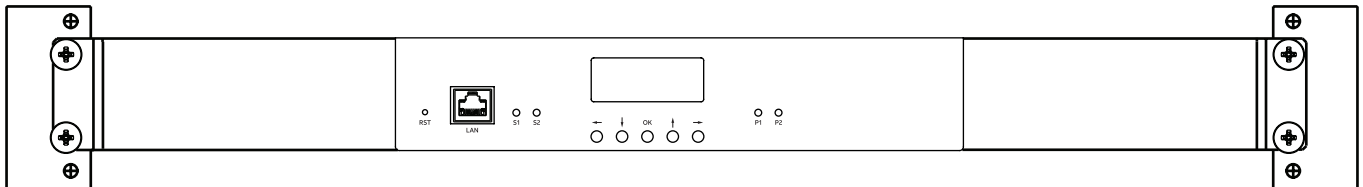

2. Connect AC power. Be sure to secure the power cord so that it does not become pinched, is protected from being stepped on and does not become a trip hazard. The status lights P1-P2 should now be on.




Power Cord

3. Connect communication bus cables from rear of Channel Infrastructure Analyzer to the Phy-FiXX patch panels. Connect each patch panel to the "Horizontal patch panel" or "Equipment patch panel" ports as appropriate. As the Communication Bus Cable to each patch panel is connected the two power status lights on the control module of the patch panel should come on. Do not attempt to connect Ethernet or other LAN circuits to these RJ45 ports - they are intended only for direct connection to the Phy-FiXX patch panels.



Phy-FiXX Channel Infrastructure Analyzer - Rear View

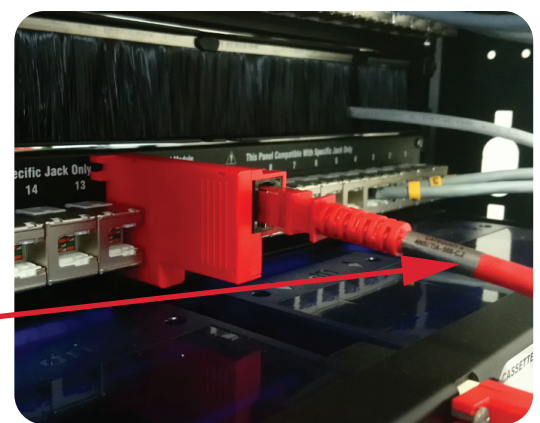

Phy-FiXX Panel - Rear View

HCS Phy-FiXX™

96 Channel Infrastructure Analyzer Installation Instructions

4. Use the Channel Infrastructure Analyzer Web Interface to Check Panel Connectivity

This section describes the process to check that the Phy-FiXX Channel Infrastructure Analyzer is connected and communicating with Phy-FiXX Patch Panels. This involves accessing the Channel Infrastructure Analyzer interface from the web browser of a PC that is connected to the LAN port of the Channel Infrastructure Analyzer. It is assumed that you have a laptop PC with a LAN port, and have a web browser installed such as Internet Explorer, Firefox, Safari, or Chrome.

- a- First make sure your PC is not connected to any LANs – neither wired nor wireless. If your PC has a wireless card please turn its power off or otherwise disable it.
- b- Set IP address to fixed address 192.168.10.xxx where xxx is any number other than 196. For example, you could set the IP address of your PC's LAN adapter to 192.168.10.1. Before doing this, be sure to make a note of your current IP settings so that when you are done you can reset your PC to its prior configuration. The methods for viewing and then setting the IP address varies depending on your operating system – for reference, the method for Windows XP is outlined in the section "Setting Your IP Address."
- c- Connect a patch cord from the LAN port of your PC to the LAN Port on the front of the Phy-FiXX Channel Infrastructure Analyzer.
- d- Press the reset button on the front of the Channel Infrastructure Analyzer and wait at least 30 seconds.
- e- Start your internet browser application, and enter the address 192.168.10.196 in the address bar of the browser
- this is the default IP address for the Channel Infrastructure Analyzer's LAN port. The welcome screen of the Channel Infrastructure Analyzer interface will appear.
- f- Click "Sign In" and log into the Channel Infrastructure Analyzer interface using the default settings of
User Name = admin
and Password = admin.
- g- The status of each Channel Infrastructure Analyzer bus port on the rear of the Channel Infrastructure Analyzer will appear as either:
i) green, meaning that the Channel Infrastructure Analyzer is properly communicating to a patch panel through that particular Channel Infrastructure Analyzer bus port, or
ii) black, meaning that the Channel Infrastructure Analyzer is not communicating through that port. This means that either there is no patch panel connected or there is an issue with the patch panel.
- h- You may want to save a screen capture of this web page to document that all panels are properly connected to the Channel Infrastructure Analyzer.
- i- When finished with testing, sign out of the web interface, exit from your web browser, and disconnect your PC from the Channel Infrastructure Analyzer "LAN" port.
- j- Reset the IP configuration of your PC to its original configuration.

5. Disconnect the Channel Infrastructure Analyzer from its power source. This will clear the LEDs that remain lit.

6. When the network administrator is ready for the Channel Infrastructure Analyzer to be connected to the network and the Phy-FiXX server, connect the Channel Infrastructure Analyzer "LAN" port to the network, using a Category 5e or better patch cord, and reconnect power to the Channel Infrastructure Analyzer.

HCS Phy-FiXX™

96 Channel Infrastructure Analyzer Installation Instructions

Next Steps:

This completes the basic hardware installation steps of the Channel Infrastructure Analyzer. You are now ready to begin initializing the Phy-FiXX application server and establishing communication between the server and Channel Infrastructure Analyzer. This process is not covered here - refer to the "Phy-FiXX Server Installation Guide" for details. Status lights S1 and S2 on the front of the Channel Infrastructure Analyzer will remain off until a communication link has been established between the Channel Infrastructure Analyzer and the Phy-FiXX application server.

Supplementary Information

In order to connect your PC directly to the LAN port of the Channel Infrastructure Analyzer you must set the IP address of the LAN adapter in your PC to a fixed IP address. If the Channel Infrastructure Analyzer is already connected to a network and configured with a valid IP address this step is not necessary - just point your web browser to the IP address or URL of the Channel Infrastructure Analyzer, as set by the system administrator. Following is the procedure for computers running Microsoft Windows XP; the procedure for other operating system will vary.

Setting your IP address in Windows XP

1. Log on to the computer using an account with administrator privileges.
2. Click Start, then click Control Panel.
3. In Control Panel, double-click Network Connections. The Network and Dial-up Connections dialog box opens.
4. Right-click the local area connection that you want, and then click Properties. The Local Area Network Connection Properties dialog box opens.
5. In the this connection uses the following items box, click Internet Protocol (TCP/IP), and then click Properties. The Internet Protocol (TCP/IP) Properties dialog box appears.
6. Click Use the following IP address to specify the IP address for the network adapter.
7. In the IP address box, type the IP address that you want to be assigned to this network adapter - for example 192.168.10.1
8. You can leave the Subnet mask, Default gateway, Preferred DNS server, and Alternate DNS server boxes blank.
9. Click OK. In the Local Area Connection Properties dialog box, click OK.
10. Close the Network and Dial-up Connections window.

You are now ready to connect your PC to the LAN port of the Channel Infrastructure Analyzer.

Resetting Your IP Configuration to Dynamic IP

Use these steps to configure the computer to obtain an IP address from a DHCP server.

1. Click Start, then click Control Panel.
2. In Control Panel, double-click Network Connections. The Network and Dial-up Connections dialog box opens.
3. Right-click the local area connection that you want, and then click Properties. The Local Area Network Connection Properties dialog box opens.
4. In the this connection uses the following items box, click Internet Protocol (TCP/IP), and then click Properties. The Internet Protocol (TCP/IP) Properties dialog box appears.
5. Click Obtain an IP address automatically.
6. Click Obtain DNS server address automatically if you do not want to specify the IP address of the Domain Name System (DNS) server.
7. Click OK. In the Local Area Connection Properties dialog box, click OK.
8. Click Start, and then click Run.
9. In the Open box, type cmd, and then click OK.
10. At the command prompt, type ipconfig /release, and then press ENTER.
11. Type ipconfig /renew, and then press ENTER to confirm the new IP settings.
12. Type exit and then press ENTER to quit the command prompt

HCS Phy-FiXX™

96 Channel Infrastructure Analyzer Installation Instructions

CONSIDÉRATIONS DE SÉCURITÉ

Suivez ces importantes directives de sécurité en plaçant et en raccordant votre système d'administration d'infrastructure :

- Ne pas bloquer les fentes et les ouvertures.
- Ne rien placer au dessus de l'unité.
- Ne pas placer l'unité dans un lieu fermé qui limiterait l'écoulement d'air autour de l'unité.
- Ne pas placer l'unité près d'aucune source de chaleur externe qui pourrait hausser la température autour de l'unité.
- Ne pas placer l'unité sur le haut d'un autre dispositif électronique produisant de la chaleur.
- Permettre une suffisante ventilation autour de l'unité pour maintenir une température normale du fonctionnement.
- Ne pas placer l'unité dans une cellule fermée sans fournir une suffisante aération.
- Ne pas broncher la fiche LAN transportant dans l'unité des connecteurs RJ45 sur le panneau arrière.
- Il existe un risque d'explosion si les piles sont remplacées par des piles d'un type incorrect. Jetez les piles usées selon les instructions.

إرشادات سلامة هامة

إشعارات سلامة هامة

- تعمل الماسحة "أم أي أي أم" بتيار متردد ١١٠ فولت أو ٢٢٠ فولت. كما هو الحال مع كل الأجهزة الكهربائية، يمثل اتباع لوائح استخدام الكهرباء المحلية أثناء تركيب الجهاز أهمية بالغة.
- بالنسبة لأمريكا الشمالية، يجب تركيب الجهاز بالتوافق مع متطلبات قانون الكهرباء القومي® وقانون الكهرباء الكندي.
- احرص على عدم ملامسة الجهاز أو انغماسه في المياه أو أي سوائل أخرى.
- تنظيف الجهاز يكون بقطعة قماش جافة.
- يجب تركيب هذا الجهاز في أجواء مناسبة، تكون درجتي الحرارة والرطوبة بها ملائمة.
- احرص على التهوية الجيدة للمنطقة المحيطة بالوحدة للحفاظ على درجة حرارة التشغيل الطبيعية. احرص على غلق فتحات التهوية.
- لا تحاول فتح غلاف الجهاز، أو تفكيكه أو تغيير أي جزء من الجهاز. أي عمليات فتح للغلاف أو تغيير للمكونات داخل الجهاز من شأنها إلغاء الضمان.
- لا تحاول توصيل دوائر إيثرنت في أي من مقابس "آر جي ٤٥" على الجزء الخلفي من الوحدة – فهذه منافذ توصيل بيانات مخصصة لتوصيل كبلات نقل البيانات إلى لوحات "أم أي أي أم".
- استبدال البطارية بنوع غير صحيح سوف يتسبب في حدوث انفجار. تخلص من البطاريات بشكل سليم.